

4-Digit Multi Panel Meters

MT4Y Series

INSTRUCTION MANUAL

DRW170797AF

Autonics

Thank you for choosing our Autonics product.

Read and understand the instruction manual and manual thoroughly before using the product.

For your safety, read and follow the below safety considerations before using.

For your safety, read and follow the considerations written in the instruction manual, other manuals and Autonics website.

Keep this instruction manual in a place where you can find easily.

The specifications, dimensions, etc. are subject to change without notice for product improvement. Some models may be discontinued without notice.

Follow Autonics website for the latest information.

Safety Considerations

- Observe all 'Safety Considerations' for safe and proper operation to avoid hazards.
- ⚠ symbol indicates caution due to special circumstances in which hazards may occur.

⚠ Warning Failure to follow instructions may result in serious injury or death.

- Fail-safe device must be installed when using the unit with machinery that may cause serious injury or substantial economic loss. (e.g. nuclear power control, medical equipment, ships, vehicles, railways, aircraft, combustion apparatus, safety equipment, crime / disaster prevention devices, etc.)**
Failure to follow this instruction may result in personal injury, economic loss or fire.
- Do not use the unit in the place where flammable / explosive / corrosive gas, high humidity, direct sunlight, radiant heat, vibration, impact or salinity may be present.**
Failure to follow this instruction may result in explosion or fire.
- Install on a device panel to use.**
Failure to follow this instruction may result in fire or electric shock.
- Do not connect, repair, or inspect the unit while connected to a power source.**
Failure to follow this instruction may result in fire or electric shock.
- Check 'Connections' before wiring.**
Failure to follow this instruction may result in fire.
- Do not disassemble or modify the unit.**
Failure to follow this instruction may result in fire or electric shock.

⚠ Caution Failure to follow instructions may result in injury or product damage.

- When connecting the power / measurement input and relay output, use AWG 24 (0.20 mm²) to AWG 15 (1.65 mm²) cable or over and tighten the terminal screw with a tightening torque of 0.98 to 1.18 N m. Use the wiring suitable for the load current capacity.**
Failure to follow this instruction may result in fire or malfunction due to contact failure.
- Use the unit within the rated specifications.**
Failure to follow this instruction may result in fire or product damage.
- Use a dry cloth to clean the unit, and do not use water or organic solvent.**
Failure to follow this instruction may result in fire or electric shock.
- Keep the product away from metal chip, dust, and wire residue which flow into the unit.**
Failure to follow this instruction may result in fire or product damage.

Cautions during Use

- Follow instructions in 'Cautions during Use'. Otherwise, it may cause unexpected accidents.
- Power supply should be insulated and limited voltage / current or Class 2, SELV power supply device.
- Install a power switch or circuit breaker in the easily accessible place for supplying or disconnecting the power.
- Keep away from high voltage lines or power lines to prevent inductive noise. In case installing power line and input signal line closely, use line filter or varistor at power line and shielded wire at input signal line.
- Do not use near the equipment which generates strong magnetic force or high frequency noise.

Connection with the line filter	Connection with the varistor

- This unit may be used in the following environments.
 - Indoors (in the environment condition rated in 'Specifications')
 - Altitude max. 2,000 m
 - Pollution degree 2
 - Installation category II

Manuals

For the detailed information about communication, etc., please refer to the manuals, and be sure to follow cautions written in the technical descriptions. Visit Autonics web site to download manuals.

Ordering Information

This is only for reference.

For selecting the specified model, follow the Autonics website.

MT 4 Y - ① - 4 ②

① Input type

DV: DC voltage⁽⁰¹⁾

DA: DC current

AV: AC voltage⁽⁰²⁾

AA: AC current⁽⁰²⁾

② Preset output + Sub output


	Preset output	Sub output
N	None (indicator)	
0	Relay	-
1	NPN open collector	-
2	PNP open collector	-
3	Relay (Low out)	Transmission (DC 4 - 20 mA)
4	Relay (Low out)	RS485 Communication
5	-	BCD Dynamic
6	-	Low speed serial

(01) To measure the current over DC 5 A, select DV type because the shunt should be used.


(02) In case of selecting frequency display, no output will be provided even if it is output support model.

Dimensions


- Unit: mm, For the detailed drawings, follow the Autonics website.

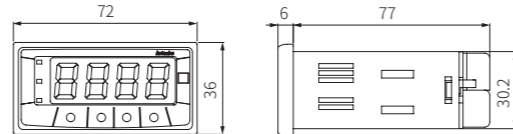


- Except BCD Dynamic sub output model

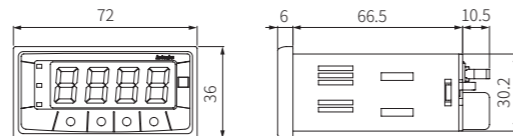

Bracket



Panel cut-out

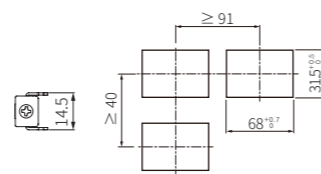

Cautions during Wiring

Use the Copper-conductor wire with the temperature class 60°C.


- Unit: mm, Use terminals of size specified below.
- Contact the manufacturer for the socket and cable.

	Model
Hirose connector	HIF3BA-14PA-2.54DS
Hirose connector socket	HIF3BA-14D-2.54R


Connections

Input

• DC voltage

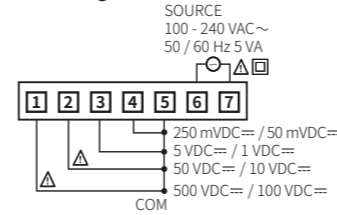


• AC voltage

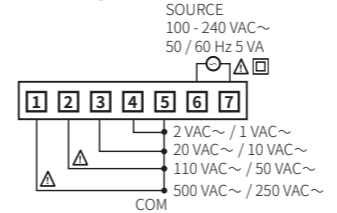


Output


• 0: Relay



• 2: PNP open collector




• 4: Relay + RS485 comm.

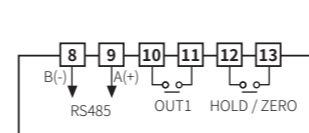


• 6: Low speed serial


POL: When a display value is (-) the signal of (-) will be outputted.

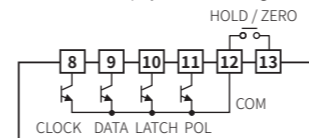


• DC current




• AC current




• 1: NPN open collector



• 3: Relay + Transmission (DC 4 - 20 mA)



• 5: BCD Dynamic

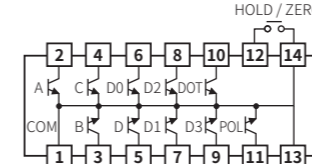

Specifications

Model	MT4Y-DV-4□	MT4Y-DA-4□	MT4Y-AV-4□	MT4Y-AA-4□
Input type	DC voltage	DC current	AC voltage ⁽⁰¹⁾	AC current ⁽⁰¹⁾
Max. allowable input	≈ 110% F.S. for each measured input range			
Display method	7-segment (red) LED (character height: 14.2 mm)			
Display accuracy	Dependent on the ambient temperature			
23 ± 5°C	± 0.1% F.S. rdg ± 2 digit	± 0.1% F.S. rdg ± 2 digit ⁽⁰²⁾	± 0.3% F.S. rdg ± 3 digit	± 0.3% F.S. rdg ± 3 digit
-10 to 50°C	± 0.5% F.S. rdg ± 3 digit			
Max. display range	-1999 to 9999 (4 digit)			
A / D conversion method	ΣΔ (Sigma Delta) ADC			
Sampling cycle	50 ms	16.6 ms		
Unit weight (packaged)	≈ 134 g (≈ 213.5 g)			
Approval	CE, RoHS, ENEC			

(01) Available frequency display, Display accuracy (23 ± 5°C): ± 0.1% F.S. rdg ± 2 digit

(02) 5 A terminal: ± 0.3% F.S. rdg ± 3 digit

Preset output	None (indicator) / Relay / NPN open collector / PNP open collector output model
Relay	Contact capacity: 250 VAC~ 3 A, 30 VDC~ 3 A Contact composition: N.O (1a)
NPN / PNP open collector	Output capacity: ≤ 12 - 24 VDC~ ± 2 VDC~, 50 mA resistive load
Sub output	None (indicator) / BCD Dynamic / Transmission (DC 4 - 20 mA) / Low speed serial / RS485 Communication output model
BCD Dynamic / Low speed serial	NPN open collector output Output capacity: ≤ 12 - 24 VDC~, 50 mA resistive load
Transmission (DC 4 - 20 mA)	Resolution: 1/12,000 (load resistance: ≤ 600 Ω) Response time: ≤ 450 ms
RS485 communication	Protocol: Modbus RTU

Power supply	100 - 240 VAC~ ± 10% 50 / 60 Hz
Power consumption	5 VA
Insulation resistance	≥ 100 MΩ (500 VDC~ megger, between external terminal and case)
Dielectric strength	2,000 VAC~ 50 / 60 Hz for 1 min (between external terminal and case)
Noise immunity	± 2 kV the square wave noise (pulse width: 1 μs) by the noise simulator
Vibration	0.75 mm amplitude at frequency of 10 to 55 Hz (for 1 min) in each X, Y, Z direction for 2 hours
Vibration (malfunction)	0.5 mm amplitude at frequency of 10 to 55 Hz (for 1 min) in each X, Y, Z direction for 10 min
Shock	300 m/s ² (≈ 30 G) in each X, Y, Z direction for 3 times
Shock (malfunction)	100 m/s ² (≈ 10 G) in each X, Y, Z direction for 3 times
Relay life cycle	Mechanical: ≥ 20,000,000 operations Electrical: ≥ 100,000 operations (250 VAC~ 3A resistive load)
Ambient temp.	-10 to 50°C, storage: -20 to 60°C (rated at no freezing or condensation)
Ambient humi.	35 to 85%RH, storage: 35 to 85%RH (rated at no freezing or condensation)
Protection structure	IP50 (front part, IEC standard)
Insulation type	Double insulation or reinforced insulation (mark: □, dielectric strength between the measurement input part and the power part: 1 kV)

RS485 communication Interface


Communication protocol	Modbus RTU
Connection	RS485
Application standard	Compliance with EIA RS485
Max. connections	31 units (address: 01 to 99)
Synchronous method	Asynchronous
Communication method	Two-wire half duplex
Communication distance	Max. 800 m
Communication speed	1200, 2400, 4800, 9600, 19200, 38400 bps
Start bit	1 bit (fixed)
Data bit	8 bit (fixed)
Parity bit	NONE, EVEN, ODD
Stop bit	1 bit, 2 bit

DAQMaster

- DAQMaster is the comprehensive device management program for Autonics' products, providing parameter setting, monitoring and data management.
- Visit our website to download the DAQMaster installer and user manual.

Item	Minimum requirements
System	IBM PC compatible computer with Intel Pentium III or above
Operating system	Microsoft Windows 98 / NT / XP / Vista / 7 / 8 / 10
Memory	256MB or more
Hard disk	More than 1GB of free hard disk space
VGA	1024 × 768 higher resolution display
Others	RS232 serial port (9-pin), USB port

Mode Setting

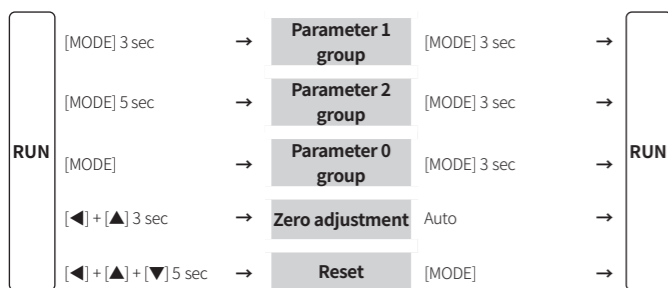

Parameter Setting

- Some parameters are activated / deactivated depending on the model or setting of other parameters. Refer to the description of each parameter.
- If any key is not entered for 60 sec in each parameter, it returns to RUN mode.
- After returning to RUN mode, press the [MODE] key within 2 sec, it returns to previous parameter.
- [MODE] key: Saves current setting value and moves to the next parameter.
- [◀] key: Checks fixed value / Changes setting digits.
- [▲], [▼] key: Changes setting values.

Parameter 1 group

Parameter	Display	Defaults	Setting range	Display condition
1-1 Input range	I n - r	500.0	[DC voltage model], [AC voltage model] • Refer to Input Range and Display Range	-
		5A	[DC current model], [AC current model] • Refer to Input Range and Display Range	-
1-2 Display method	d I S P	5 t n d	STND: standard, SCAL: scale, FREQ: frequency ⁰¹⁾	-
1-3 Measurement method	I n - t	5 r n 5	[AC voltage model], [AC current model] T.RMS: True RMS, A.RMS: Average RMS, AVG • True RMS = $\sqrt{\frac{A_1^2 + A_2^2 + \dots + A_n^2}{n}}$ • Average RMS = $\frac{A_1 + A_2 + \dots + A_n}{n}$ × Waveform rate (n = number of display values per cycle, A = display value)	1-2 Display method: STND, SCAL
		500.0	[DC voltage model], [AC voltage model] Max. value of display range	1-2 Display method: STND
1-4 Max. display value (fixed)	5 t n d	500.0	[DC current model], [AC current model] Max. value of display range	
1-5 High-limit display value gradient correction	I n b H	100.0	0.100 to 5.000 %	-
1-6 Low-limit display value deviation correction	I n b L	00	-99 to 99	-
1-7 Decimal point position	d o t	0.0	[DC voltage model], [AC voltage model] 0, 0.0, 0.00, 0.000	1-2 Display method: SCAL & * 1-7 Decimal point position: 0.0, 0.00, 0.000
		0.000	[DC current model], [AC current model] 0, 0.0, 0.00, 0.000	
1-8 High-limit scale	H - 5 C	-	Display value against max. measurement input*	-
1-9 Low-limit scale	L - 5 C	-	Display value against min. measurement input*	-
1-10 High-limit display value gradient correction	I n b H	100.0	0.100 to 5.000 %	-
1-11 Low-limit display value deviation correction ⁰²⁾	I n b L	00	w-99 to 99	-
1-12 Decimal point position ⁰³⁾	d o t	0.0	[AC voltage model] 0, 0.0, 0.00, 0.000	1-2 Display method: FREQ
		0.000	[AC current model] 0, 0.0, 0.00, 0.000	
1-13 High-limit display value gradient correction	I n b H	100.0	0.100 to 9.999	-
1-14 Exponent of INB	I n b E	10 - 0	10-0: 10 ⁰ , 10-1: 10 ⁻¹ , 10-2: 10 ⁻² , 10 1: 10 ¹	-

01) Displays at AC voltage or AC current model only.

02) Low-limit display value deviation correction range is within -99 to 99 for D⁰, D¹ digit regardless of decimal point position.

03) Display range is variable according to decimal point position.

Dot	Display range	Frequency measurement range
0	-1999 to 9999	1 to 9999 Hz
0.0	-199.9 to 999.9	0.1 to 999.9 Hz
0.00	-19.99 to 99.99	0.10 to 99.99 Hz
0.000	-1.999 to 9.999	0.100 to 9.999 Hz

Parameter 2 group

Parameter	Display	Defaults	Setting range	Display condition
2-1 Output operation mode	o U t t	o F F	[Except indicator model] OFF, L.ST, H.ST, LH.ST, HH.ST, LL.ST, LD.ST • Refer to Output Operation Mode • Relay (Low out) output mode is available only OFF or L.ST.	-
2-2 Hysteresis	H Y S	00.1	[Except indicator model] Within 10% of max. display range, digit	2-1 Output operation mode: except OFF
2-3 Startup compensation time	S t A r t	00.0	[Except indicator model] 0.0 to 99.9 sec	-
2-4 Peak monitoring delay time	P E k t	00.5	00 to 30 sec	-
2-5 Display cycle	d I S t	0.2 5	0.1 to 5.0 sec	-
2-6 Keys for zero adjustment	E r o	n o	NO, YES • YES: Press the [◀] + [▲] keys for 3 sec to adjust zero.	-
2-7 External input terminal	E u l n	H o l d	[Except indicator model] HOLD, ZERO • If the external input terminal is short-circuited for 50 ms or more, it operates with the set function.	-
2-8 High-limit value of transmission output	F 5 - H	500.0	[DC voltage & Transmission (DC 4 - 20 mA) output model], [AC voltage & Transmission (DC 4 - 20 mA) output model] Max. value of display range	-
		500.0	[DC current & Transmission (DC 4 - 20 mA) output model], [AC current & Transmission (DC 4 - 20 mA) output model] Max. value of display range	
2-9 Low-limit value of transmission output	F 5 - L	000.0	[DC voltage & Transmission (DC 4 - 20 mA) output model], [AC voltage & Transmission (DC 4 - 20 mA) output model] Min. value of display range	-
		000.0	[DC current & Transmission (DC 4 - 20 mA) output model], [AC current & Transmission (DC 4 - 20 mA) output model] Min. value of display range	
2-10 Comm. Address	A d r S	0 1	[RS485 Comm. output model] 01 to 99	-
2-11 Comm. speed	b P S	9600	[RS485 Comm. output model] 38.4k, 19.2k, 9600, 4800, 2400, 1200 bps	-
2-12 Parity bit	P r t Y	n o n E	[RS485 Comm. output model] NONE, EVEN, ODD	-
2-13 Stop bit	S t P	2	[RS485 Comm. output model] 2, 1 bit	-
2-14 Response waiting time	r S w t	5	[RS485 Comm. output model] 5 to 99 sec	-
2-15 Lock	L o C	o F F	OFF: unlock, LOC1: lock parameter 1, LOC2: lock parameter 1, 2, LOC3: lock parameter 0, 1 and 2	-

Parameter 0 group

Parameter	Display	Defaults	Setting range	Display condition
0-1 Output high-limit output setting value	H 5 E t	500.0	[DC voltage & Preset setting model] -5 to 110% of display range [AC voltage & Preset setting model] 0 to 110% of display range	2-1 Output operation mode: except OFF
		500.0	[DC current & Preset setting model] -5 to 110% of display range [AC current & Preset setting model] 0 to 110% of display range	
0-2 Output low-limit output setting value	L 5 E t	000.0	[DC voltage & Preset setting model] -5 to 110% of display range [AC voltage & Preset setting model] 0 to 110% of display range	2-1 Output operation mode: except OFF
		000.0	[DC current & Preset setting model] -5 to 110% of display range [AC current & Preset setting model] 0 to 110% of display range	
0-3 Display max. peak value ⁰¹⁾	H P E t	0.0	[DC voltage], [AC voltage] Max. peak value in run mode	2-1 Output operation mode: except OFF & 2-4 Peak monitoring delay time: except 00
		0.000	[DC current], [AC current] Max. peak value in run mode	
0-4 Display min. peak value ⁰¹⁾	L P E t	0.0	[DC voltage], [AC voltage] Min. peak value in run mode	2-1 Output operation mode: except OFF & 2-4 Peak monitoring delay time: except 00
		0.000	[DC current], [AC current] Min. peak value in run mode	

01) Reset: Press any one of [◀], [▼], [▲] keys.

Input Range and Display Range

When the max. input value is over the 100%, it may result in input terminal damage.

DC voltage model

Input range	Display range		Input impedance
	Diaplay method: STND (fixed)	Diaplay method: SCAL ⁰¹⁾	
0 - 500 VDC≡	0.0 to 500.0	500.0	4.33 MΩ
0 - 100 VDC≡	0.0 to 100.0	100.0	4.33 MΩ
0 - 50 VDC≡	0.00 to 50.00	50.0	433.48 kΩ
0 - 10 VDC≡	0.00 to 10.00	10.0	43.48 kΩ
0 - 5 VDC≡	0.000 to 5.000	5.0	4.348 kΩ
0 - 1 VDC≡	0.000 to 1.000	1.0	434.8 kΩ
0 - 250 mVDC≡	0.0 to 250.0	0.2 5	2.28 kΩ
0 - 50 mVDC≡	0.00 to 50.00	50.0	2.28 kΩ

01) Connect to the input terminals whose 30% to 100% of the input range includes the max. value of the input range to measure.
When the max. input value is under the 30% of the input terminal range, display accuracy is degraded.

DC current model

Input range	Display range		Input impedance
	Diaplay method: STND (fixed)	Diaplay method: SCAL ⁰¹⁾	
0 - 5 A	0.000 to 5.000	5 A	0.02 Ω
0 - 2 A	0.000 to 2.000	2 A	0.02 Ω
0 - 500 mA	0.0 to 500.0	0.5 A	0.22 Ω
0 - 200 mA	0.0 to 200.0	0.2 A	0.22 Ω
0 - 50 mA	0.00 to 50.00	50.0	2.22 Ω
4 - 20 mA	4.00 to 20.00	4 - 20	2.22 Ω
0 - 5 mA	0.000 to 5.000	5.0	22.22 Ω
0 - 2 mA	0.000 to 2.000	2.0	22.22 Ω

01) Connect to the input terminals whose 30% to 100% of the input range includes the max. value of the input range to measure.
When the max. input value is under the 30% of the input terminal range, display accuracy is degraded.

AC voltage model

Input range	Display range		Input impedance
	Diaplay method: STND (fixed)	Diaplay method: SCAL ⁰¹⁾	
0 - 500 VAC~	0.0 to 500.0	500.0	5.01 MΩ
0 - 250 VAC~	0.0 to 250.0	250.0	5.01 MΩ
0 - 110 VAC~ ⁰²⁾	0.0 to 440.0	110.0	1.11 MΩ
0 - 50 VAC~	0.00 to 50.00	50.0	1.11 MΩ
0 - 20 VAC~	0.00 to 20.00	20.0	200.92 kΩ
0 - 10 VAC~	0.00 to 10.00	10.0	200.92 kΩ
0 - 2 VAC~	0.000 to 2.000	2.0	20.92 kΩ
0 - 1 VAC~	0.000 to 1.000	1.0	20.92 kΩ

01) Connect to the input terminals whose 30% to 100% of the input range includes the max. value of the input range to measure.
When the max. input value is under the 30% of the input terminal range, display accuracy is degraded.

02) In case of 0 to 110 VAC~ of AC voltage range and using PT (potential transformer) for 440 VAC~/110 VAC~, if 110 VAC~ is input, and the unit displays 440 VAC~ automatically by preset scale value for PT user's convenience.

AC current model

Input range	Display range		Input impedance
	Diaplay method: STND (fixed)	Diaplay method: SCAL ⁰¹⁾	
0 - 5 A	0.000 to 5.000	5 A	0.02 Ω
0 - 2.5 A	0.000 to 2.500	2.5 A	0.02 Ω
0 - 1 A	0.000 to 1.000	1 A	0.10 Ω
0 - 500 mA	0.0 to 500.0	0.5 A	0.20 Ω
0 - 250 mA	0.0 to 250.0	0.2 5 A	0.20 Ω
0 - 100 mA	0.0 to 100.0	0.1 A	1.02 Ω
0 - 50 mA	0.00 to 50.00	50.0	1.02 Ω

01) Connect to the input terminals whose 30% to 100% of the input range includes the max. value of the input range to measure.
When the max. input value is under the 30% of the input terminal range, display accuracy is degraded.

Output Operation Mode

- H.SET or L.SET is displayed according to the output operation mode setting. In case of output operation mode as OFF, H.SET and L.SET are not displayed.
- When changing output operation mode, high-limit / low-limit output setting value, hysteresis are reset.

MODE	Output operation	Preset output		
		LO ON	HI ON	GO ON
	H.SET L.SET 	ON OFF	HI H: Hysteresis	
o F F		No output		
L 5 t	GO LO 	L.SET ≥ Display value	-	L.SET < Display value
H 5 t	HI GO 	-	H.SET ≤ Display value	H.SET > Display value
L H 5 t	GO HI LO 	L.SET ≥ Display value	H.SET ≤ Display value	L.SET < Display value < H.SET
H H 5 t	HI GO LO 	L.SET ≤ Display value	H.SET ≤ Display value	L.SET > Display value
L L 5 t	GO HI LO 	L.SET ≥ Display value	H.SET ≥ Display value	H.SET < Display value
L d 5 t	GO LO 	Second L.SET ≥ Display value	-	L.SET < Display value

Reset

- Press the [◀] + [▲] + [▼] keys for over 5 sec. in run mode, INIT flashes for 0.5 sec.
- Press the direction keys to flash NO for 0.5 sec in turn.
- Change the setting value as YES by pressing the direction keys.
- Press the [MODE] key to reset all parameter values as default and to return to run mode.

Error

Error display is released automatically when it is in the measured and display range.

Display	Description	Troubleshooting
H H H H	Flashes when measurement input is exceeded the max. allowable input (110%)	Disconnect power supply and check the cables.
L L L L ⁰¹⁾	Flashes when measurement input is exceeded the min. allowable input (-10%)	
d - H H	Turns ON when display input is exceeded high-limit scale setting value or max. display range (9999)	Reset within the display range.
d - L L	Turns ON when display input is exceeded low-limit scale setting value or min. display range (-1999)	
F - H H	Turns ON when input frequency is exceeded the max. display value of measured range	-
o u E r	Flashes twice when it exceeds zero range (±99) and returns to run mode	Reset within the zero range.

01) Displays at DC input model only.